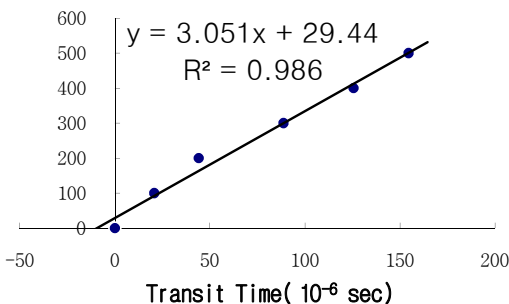
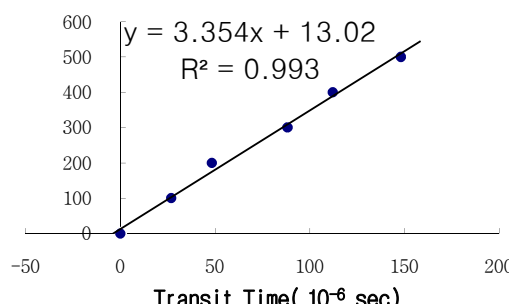
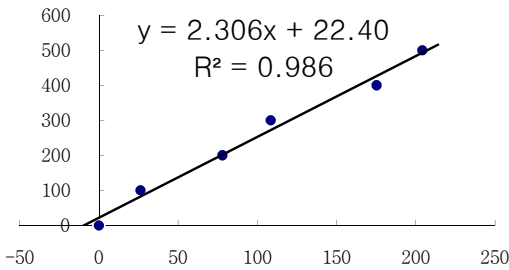
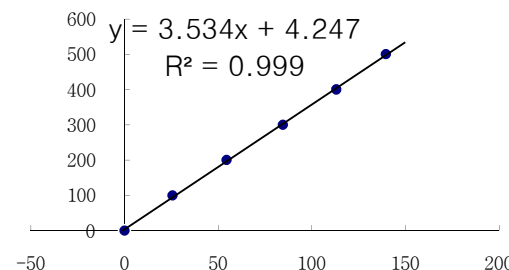


Pulse Velocity Data Sheet



(Vi : Indirect Pluse Velocity, Vd : Direct Pluse Velocity)



여과지 지하벽체		염소투입탱크 지하벽체	
X : 전달시간 (μsec)	Y : 전달거리 (mm)	X : 전달시간 (μsec)	Y : 전달거리 (mm)
0	0	0	0
20.8	100	26.9	100
44.1	200	48.3	200
88.7	300	88.3	300
125.6	400	112.2	400
154.5	500	148.2	500
Vi=	3.0513	Vi=	3.3542
Vd=	3.20	Vd=	3.52
추정 압축강도(s_{ck})	C등급(검사를 요한다)	추정 압축강도(s_{ck})	C등급(검사를 요한다)
			

탈수기동 지하벽체		배출수지펌프실 지하벽체	
X : 전달시간 (μsec)	Y : 전달거리 (mm)	X : 전달시간 (μsec)	Y : 전달거리 (mm)
0	0	0	0
26.3	100	25.6	100
78.0	200	54.5	200
108.5	300	84.6	300
175.2	400	113.0	400
204.1	500	139.5	500
Vi=	2.3063	Vi=	3.3543
Vd=	2.42	Vd=	3.52
추정 압축강도(s_{ck})	C등급(검사를 요한다)	추정 압축강도(s_{ck})	C등급(검사를 요한다)
			

Pulse Velocity Data Sheet

(Vi : Indirect Pluse Velocity, Vd : Direct Pluse Velocity)

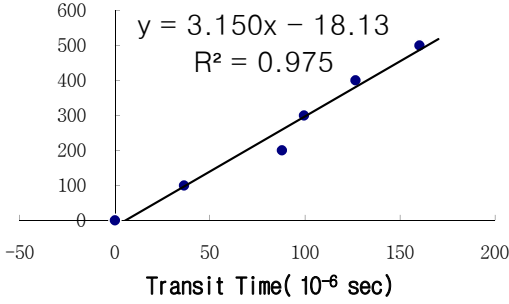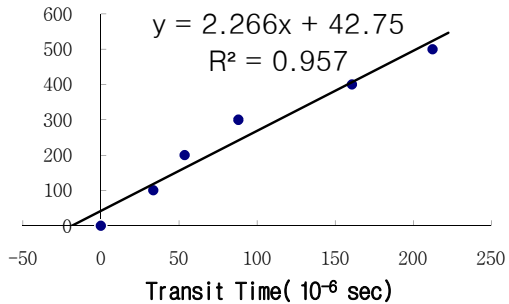송수펌프실 지하벽체		배출수지펌프실 지하벽체	
X : 전달시간 (μsec)	Y : 전달거리 (mm)	X : 전달시간 (μsec)	Y : 전달거리 (mm)
0	0	0	0
36.4	100	33.6	100
87.9	200	53.6	200
99.6	300	88.1	300
126.6	400	160.8	400
160.2	500	212.5	500
Vi=	3.1502	Vi=	2.2667
Vd=	3.31	Vd=	2.38
추정 압축강도(s_{ck})	C등급(검사를 요한다)	추정 압축강도(s_{ck})	C등급(검사를 요한다)
			

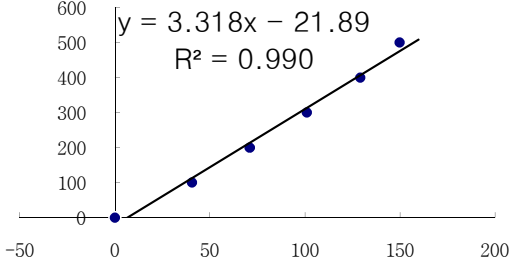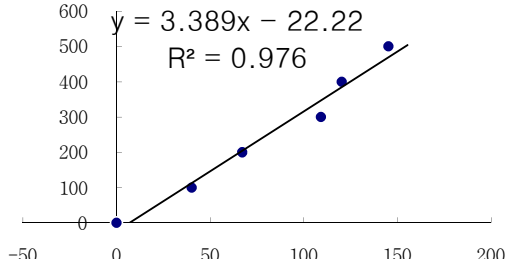배슬러지지 A지		배슬러지지 B지	
X : 전달시간 (μsec)	Y : 전달거리 (mm)	X : 전달시간 (μsec)	Y : 전달거리 (mm)
0	0	0	0
40.6	100	40.1	100
71.0	200	67.2	200
101.1	300	109.1	300
129.1	400	120.3	400
149.8	500	145.2	500
Vi=	3.3185	Vi=	3.3894
Vd=	3.48	Vd=	3.56
추정 압축강도(s_{ck})	C등급(검사를 요한다)	추정 압축강도(s_{ck})	C등급(검사를 요한다)
			

Pulse Velocity Data Sheet

(Vi : Indirect Pluse Velocity, Vd : Direct Pluse Velocity)

농축조 A지		농축조 B지	
X : 전달시간 (μsec)	Y : 전달거리 (mm)	X : 전달시간 (μsec)	Y : 전달거리 (mm)
0	0	0	0
35.2	100	35.6	100
62.3	200	62.7	200
89.8	300	90.8	300
121.2	400	125.4	400
150.8	500	153.7	500
Vi=	3.363	Vi=	3.2786
Vd=	3.53	Vd=	3.44
추정 압축강도(s_{ck})	C등급(검사를 요한다)	추정 압축강도(s_{ck})	C등급(검사를 요한다)
