


호남고속선 정지고가 _304(59.012~59.019km, S57-2)

59K019

59K012

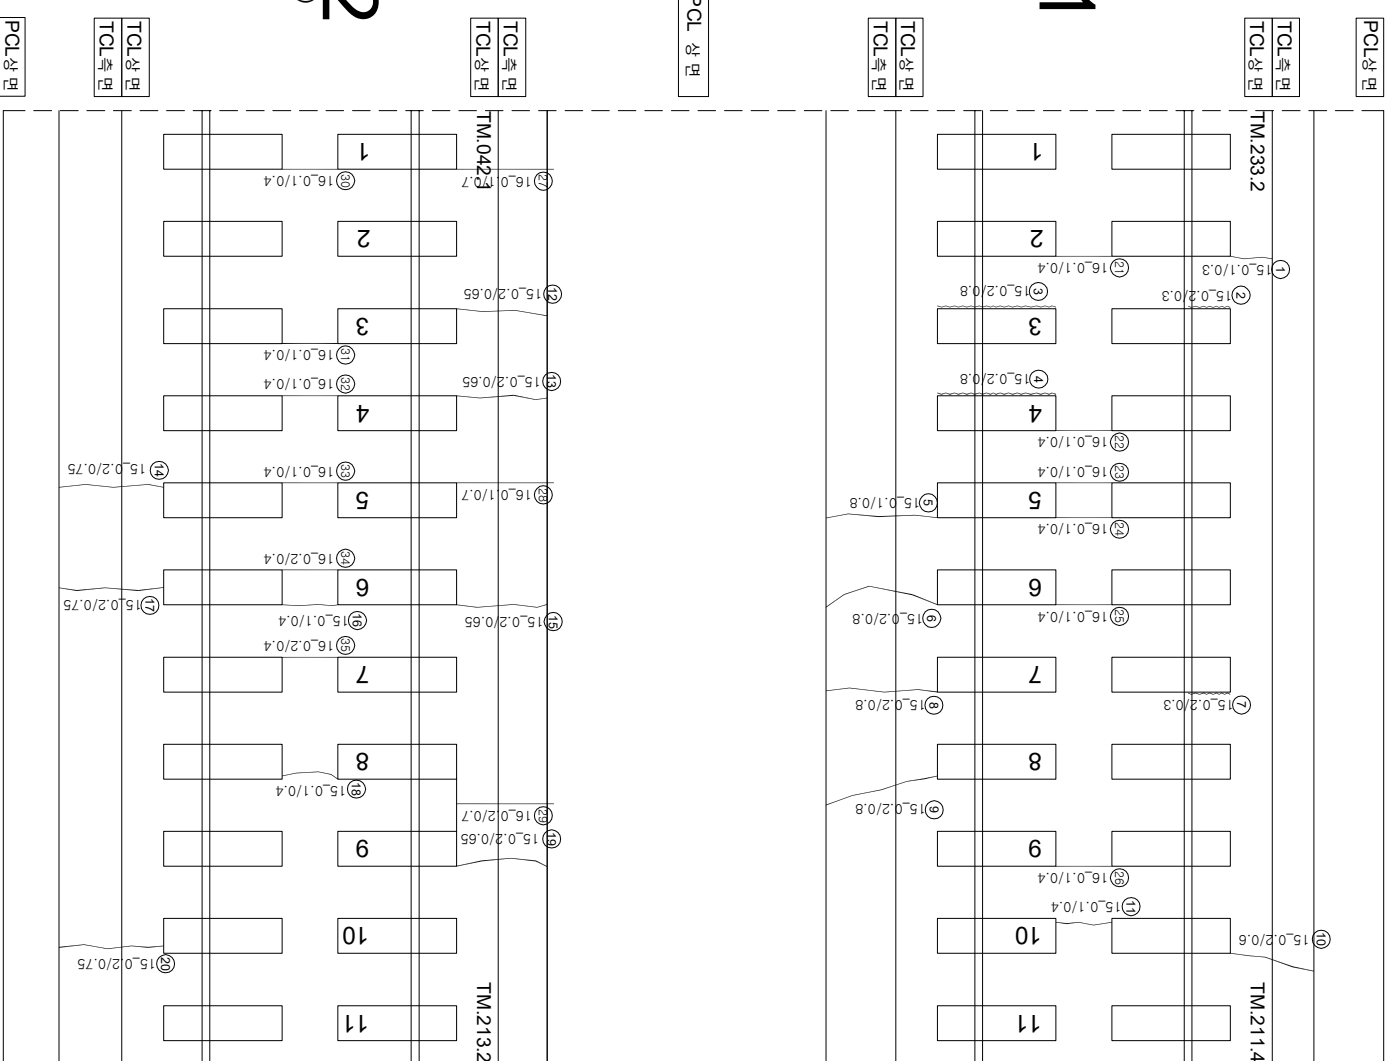

연번	순상	목	연장	비고	연번	순상	목	연장	비고
1	균열	0.1 mm	0.3 m		55				
2	경계부 균열	0.2 mm	0.3 m		56				
3	경계부 균열	0.2 mm	0.8 m		57				
4	경계부 균열	0.2 mm	0.8 m		58				
5	균열	0.1 mm	0.8 m		59				
6	균열	0.2 mm	0.8 m		60				
7	경계부 균열	0.2 mm	0.3 m		61				
8	균열	0.2 mm	0.8 m		62				
9	균열	0.2 mm	0.8 m		63				
10	균열	0.2 mm	0.6 m		64				
11	균열	0.1 mm	0.4 m		65				
12	균열	0.2 mm	0.7 m		66				
13	균열	0.2 mm	0.7 m		67				
14	균열	0.2 mm	0.8 m		68				
15	균열	0.2 mm	0.7 m		69				
16	균열	0.1 mm	0.4 m		70				
17	균열	0.2 mm	0.8 m		71				
18	균열	0.1 mm	0.4 m		72				
19	균열	0.2 mm	0.7 m		73				
20	균열	0.2 mm	0.8 m		74				
21	균열	0.1 mm	0.4 m		75				
22	균열	0.1 mm	0.4 m		76				
23	균열	0.1 mm	0.4 m		77				
24	균열	0.1 mm	0.4 m		78				
25	균열	0.1 mm	0.4 m		79				
26	균열	0.1 mm	0.4 m		80				
27	균열	0.1 mm	0.7 m		81				
28	균열	0.1 mm	0.7 m		82				
29	균열	0.2 mm	0.7 m		83				
30	균열	0.1 mm	0.4 m		84				
31	균열	0.1 mm	0.4 m		85				
32	균열	0.1 mm	0.4 m		86				
33	균열	0.1 mm	0.4 m		87				
34	균열	0.2 mm	0.4 m		88				
35	균열	0.2 mm	0.4 m		89				
36					90				
37					91				
38					92				
39					93				
40					94				
41					95				
42					96				
43					97				
44					98				
45					99				
46					100				
47					101				
48					102				
49					103				
50					104				
51					105				
52					106				
53					107				
54					108				

KORAIL 한국철도공사 KOREA RAILCOOD									
시	공	사	공	역	명	공	역	사	이 복 영
(주) 한국구조물안전연구원 (주) 한국토목안전연구원 (제) 한국건설품질연구원									
관 장									라온강 김연기 윤석기
구 간									원
 0.220 (0.30m)하 : 특색									원목도상신리
 0.420 (0.50m)초과 0.50m)하 : 형색									망산
 0.620 (0.50m)초과 1.00m)미만 : 정색									바리,바리,파산
 1.020 (1.00m)이상 : 반출색									반태
									양영
									시공이음관리종단리
									재문리
									철근도출
									누수유문부
									